

SCOPE: Use this plan ONLY for systems using utility-interactive Microinverters or AC Modules (ACM) not exceeding a combined system AC inverter output rating of 10 kW, with a maximum of 3 branch circuits, one PV module per inverter and with PV module ISC maximum of 10-A DC, installed on a roof of a one- or two-family dwelling or accessory structure. The photovoltaic system must interconnect to a single-phase AC service panel of 120/240 Vac with service panel bus bar rating of 225 A or less. This plan is not intended for bipolar systems, hybrid systems or systems that utilize storage batteries, charge controllers or trackers. Systems must be in compliance with current California Building Standards Codes and local amendments of the authority having jurisdiction (AHJ). Other articles of the California Electrical Code (CEC) shall apply as specified in section 690.3.

MANUFACTURER'S SPECIFICATION SHEETS MUST BE PROVIDED for proposed inverters, modules, combiner/junction boxes and racking systems. Installation instructions for bonding and grounding equipment shall be provided and local AHJs may require additional details. Listed and labeled equipment shall be installed and used in accordance with any instructions included in the listing or labeling (CEC 110.3). Equipment intended for use with PV system shall be identified and listed for the application CEC 690.4(D).

## Applicant and Site Information

Job /	Address	:	Permit #: License # and Class:							
Cont	ractor/E	ngineer Name:								
Signa	ature: _	Date:	Phone Number:							
1.	Gene	eral Requirements and System Information								
	Nu	croinverter umber of PV modules installed: umber of Microinverters installed:								
	1.1	Number of Branch Circuits, 1, 2 or 3:	_							
	1.2	Actual number of Microinverters or ACMs pe	er branch circuit: 1 2 3							
	1.3	Total AC system power rating = (Total Numb power output) = Watts	ber of Microinverters or ACMs) * (AC inverter							
	1.4	Lowest expected ambient temperature for th or for -6° to -10° C use 1.14 correction facto								

 Average ambient high temperature for this plan: = +47° C
 Note: For lower expected ambient or higher average ambient high temperatures, use Comprehensive Standard Plan.

# 2. Microinverter or ACM Information and Ratings Microinverters with ungrounded DC inputs shall be installed in accordance with CEC 690.35. Microinverter or ACM Manufacturer: Model: 2.1 Rated (continuous) AC output power: \_\_\_\_\_ Watts 2.2 Nominal AC voltage rating: \_\_\_\_\_ Volts 2.3 Rated (continuous) AC output current: Amps If installing ACMs, skip [STEPS 2.4] Maximum DC input voltage rating: \_\_\_\_\_ Volts (limited to 79 V, otherwise use the 2.4 Comprehensive Standard Plan) 2.5 Maximum AC output overcurrent protection device (OCPD) Amps 2.6 Maximum number of microinverters or ACMs per branch circuit: 3. **PV Module Information** (If installing ACMs, skip to [STEP 4]) PV Module Manufacturer: \_\_\_\_\_ Model: Module DC output power under standard test conditions (STC) = \_\_\_\_\_ Watts 3.1 Module V<sub>oc</sub> at STC (from module nameplate): \_\_\_\_\_\_ Volts Module I<sub>sc</sub> at STC (from module nameplate): \_\_\_\_\_ Amps 3.2 3.3 Adjusted PV Module DC voltage at minimum temperature = [Table 1] [cannot exceed Step 2.4]

Table 1. Module V $_{ m oc}$ at STC Based on Inverter Maximum DC Input Voltage Derived from CEC 690.7																
Microinverter Max. DC Input [STEP 2.4] (Volts)	34	37	40	43	46	49	52	55	58	61	64	67	70	73	76	79
Max. Module VOC @ STC, 1.12 (-1° to -5° C) Correction Factor (Volts)	30.4	33.0	35.7	38.4	41.1	43.8	46.4	49.1	51.8	54.5	57.1	59.8	62.5	65.2	67.9	70.5
Max. Module VOC @ STC, 1.14 (-6° to -10° C) Correction Factor (Volts)	29.8	32.5	35.1	37.7	40.4	43.0	45.6	48.2	50.9	53.5	56.1	58.8	61.4	64.0	66.7	69.3

**Project Address:** 

Contractor Signature:

**Customer Name:** 

#### 4. Branch Circuit Output Information

Fill in [Table 3] to describe the branch circuit inverter output conductor and OCPD size. Use [Table 2] for determining the OCPD and Minimum Conductor size.

Table 2. Branch Circuit OCPD and Minimum Conductor Size*											
Circuit Current (Amps)	Circuit Power (Watts)	OCPD (Amps)	Minimum Conductor Size (AWG)	Minimum Metal Conduit Size for 6 Current Carrying Conductors							
12	2880	15	12	3⁄4″							
16	3840	20	10	3∕₄″							
20	4800	25	8	1″							
24	5760	30	8	1"							

\*CEC 690.8 and 210.19 (A)(1) factored in Table 2, conductors are copper, insulation must be 90° C wet-rated. Table 2 values are based on maximum ambient temperature of 69° C, which includes 22° C adder, exposed to direct sunlight, mounted > 0.5 inches above rooftop,  $\leq$  6 current carrying conductors (3 circuits) in a circular raceway. Otherwise use Comprehensive Standard Plan.

Table 3. PV Array Configuration Summary										
	Branch 1	Branch 2	Branch 3							
Number of Microinverters or ACMs [Step 1]										
Selected Conductor Size [Table 2] (AWG)										
Selected Branch and Inverter Output OCPD [Table 2]										

#### 5. Solar Load Center (if used)

- 5.1 Solar Load Center is to have a bus bar rating not less than 100 Amps. Otherwise use Comprehensive Standard Plan.
- 5.2 Circuit Power see [STEP 1] = \_\_\_\_\_ Watts
- 5.3 Circuit Current = (Circuit Power) / (AC voltage) = \_\_\_\_\_ Amps

Table 4. Solar Load Center and Total Inverter Output OCPD and Conductor Size**											
Circuit Current (Amps)	Circuit Power (Watts)	OCPD (Amps)	Minimum Conductor Size (AWG)	Minimum Metal Conduit Size							
24	5760	30	10	1/2"							
28	6720	35	8	3/4"							
32	7680	40	8	3/4"							
36	8640	45	8	3⁄4″							
40	9600	50	8	3/1"							
41.6	≤ 10000	60	6	3/1"							

\*\*CEC 690.8 and 210.19 (A)(1) factored in Table 4, conductors are copper, insulation must be 90° C wet-rated. Table 4 values are based on maximum ambient temperature of 47° C (no rooftop temperature adder in this calculation), ≤ 3 current carrying conductors in a circular raceway. Otherwise use Comprehensive Standard Plan.

**Project Address:** 

**Contractor Signature:** 

**Customer Name:** 

#### 6. Point of Connection to Utility:

- 6.1 Load Side Connection only! Otherwise use the Comprehensive Standard Plan
- 6.2 Is the PV OCPD positioned at the opposite end from input feeder location or main OCPD location?
  - $\Box$  Yes  $\Box$  No (If No, then use 100% row in Table 5)
- 6.3 Per 705.12(D)(2): (Combined inverter output OCPD size + Main OCPD size) ≤ [bus bar size × (100% or 120%)]

Table 5. Maximum Combined Inverter Output Clrcuit OCPD											
Bus Bar Size (Amps)	100	125	125	200	200	200	225	225	225		
Main OCPD (Amps)	100	100	125	150	175	200	175	200	225		
Maximum Combined Inverter OCPD with 120% of bus bar rating (Amps)	20	50	25	60 <sup>+</sup>	60 <sup>+</sup>	40	60 <sup>+</sup>	60 <sup>+</sup>	45		
Maximum Combined Inverter OCPD with 100% of bus bar rating (Amps)	0	25	0	50	25	0	50	25	0		

<sup>+</sup>This plan limits the maximum system size to less than 10 kW, therefore the OCPD size is limited to 60 A. Reduction of Main Breaker is not permitted with this plan.

#### 7. Grounding and Bonding

Check one of the boxes for whether system is grounded or ungrounded:

□ Grounded □ Ungrounded

For Microinverters with a grounded DC input, systems must follow the requirements of GEC CEC 690.47) and EGC (CEC 690.43).

For ACM systems and Microinverters with ungrounded a DC input follow the EGC requirements of (CEC 690.43).


**Project Address:** 

**Contractor Signature:** 

**Customer Name:** 

#### 8. Markings

Informational note: ANSI Z535.4 provides guidelines for the design of safety signs and labels for application to products. A phenolic plaque with contrasting colors between the text and background would meet the intent of the code for permanency. No type size is specified, but 20 point (3/8") should be considered the minimum.

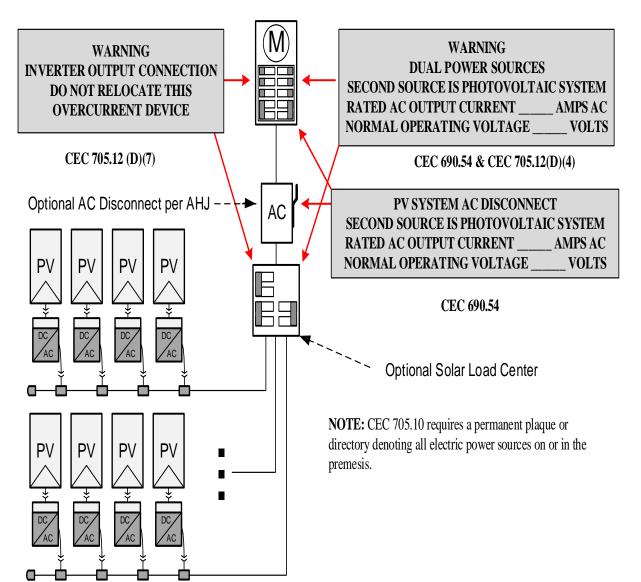


**Customer Name:** 

Contractor Signature:

# 9. Single-Inverter Line Diagram

## Solar PV Standard Plan — Simplified Central/String Inverter Systems for One- and Two-Family Dwellings

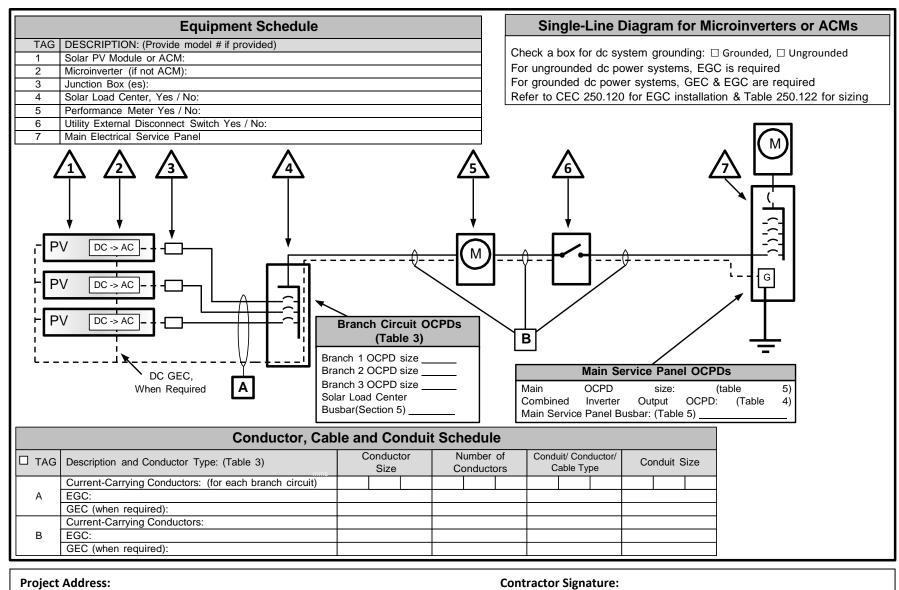

Contractor License No. & Class:

**Customer Name:** 

# **SOLAR PV STANDARD PLAN - SIMPLIFIED**

Microinverter and ACM Systems for One- and Two-Family Dwellings ROOF LAYOUT PLAN

Items required: roof layout of all panels, modules, clear access pathways and approximate locations of electrical disconnecting means and roof access points. **Project Address:** 

**Customer Name:** 

**Contractor Signature:**